


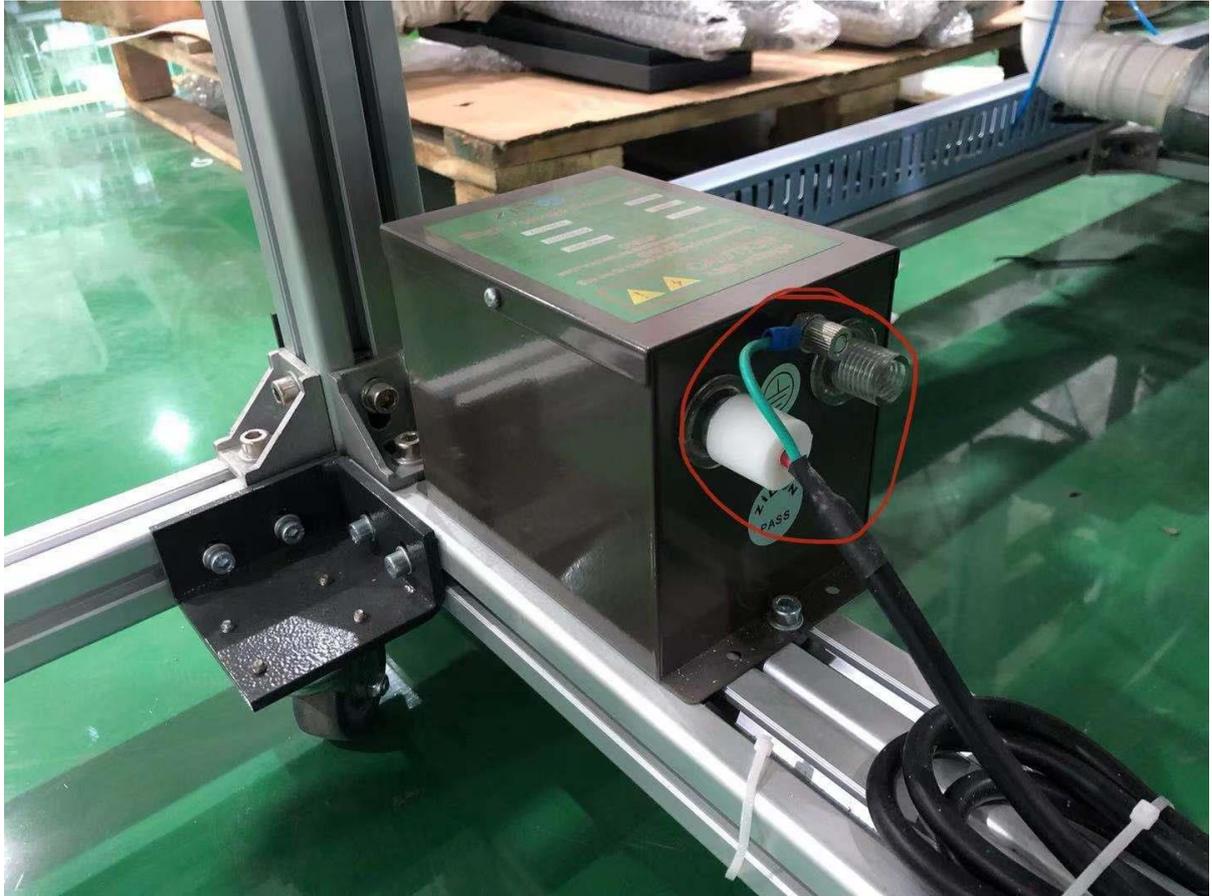


How to remove static elimination device and reconnect the trachea (PK)

1. First, you need to remove the static elimination device, remove the screws, take out the old air pipe and electrostatic device (black cable) pls refer to the photos below for details.

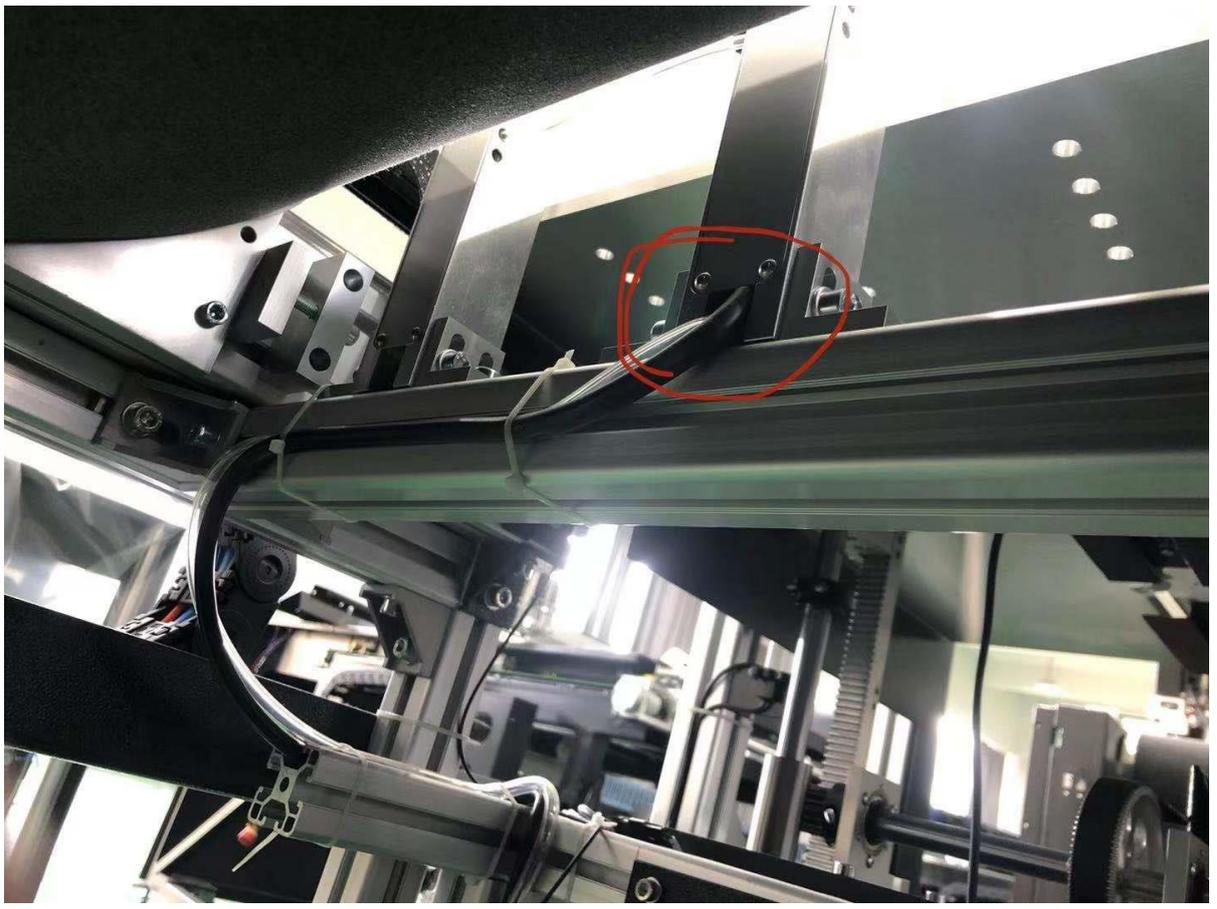

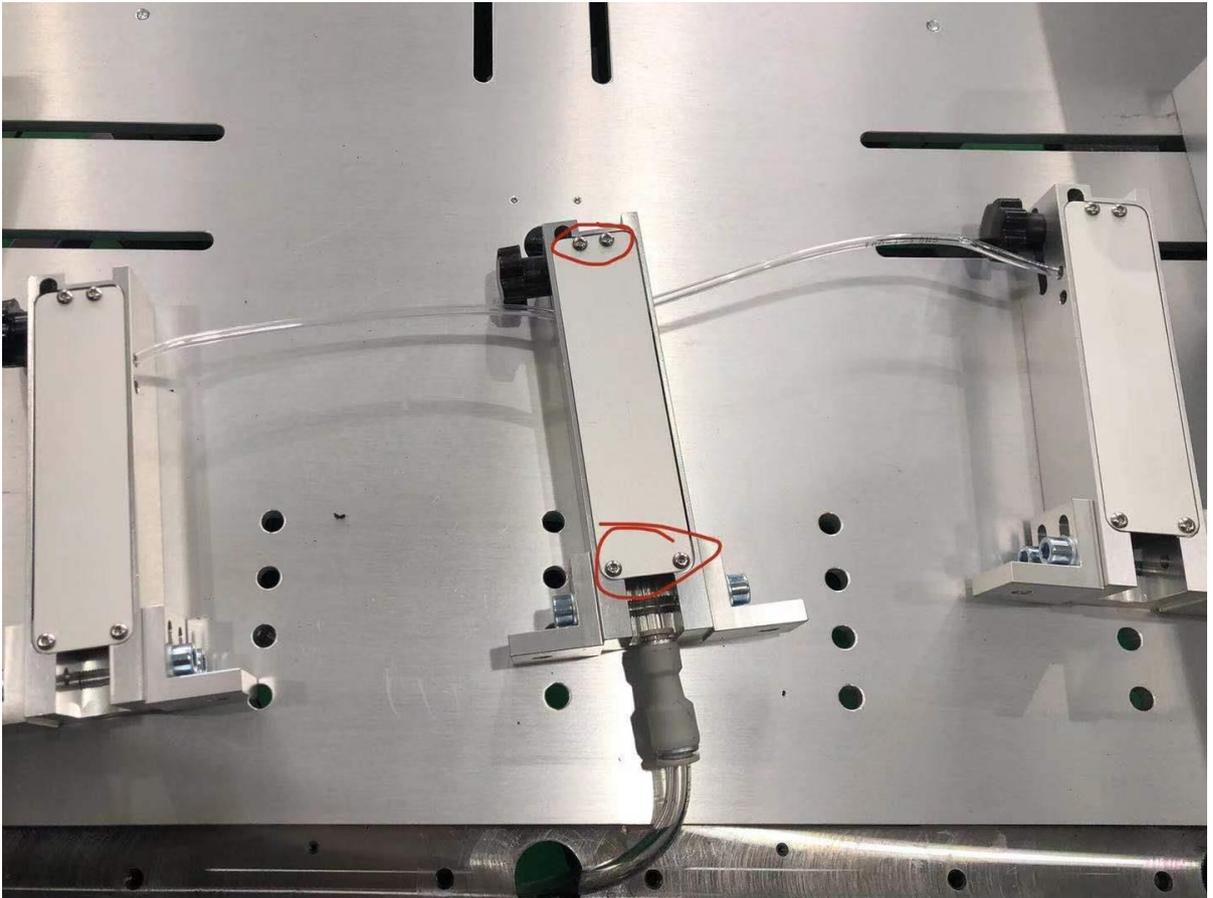

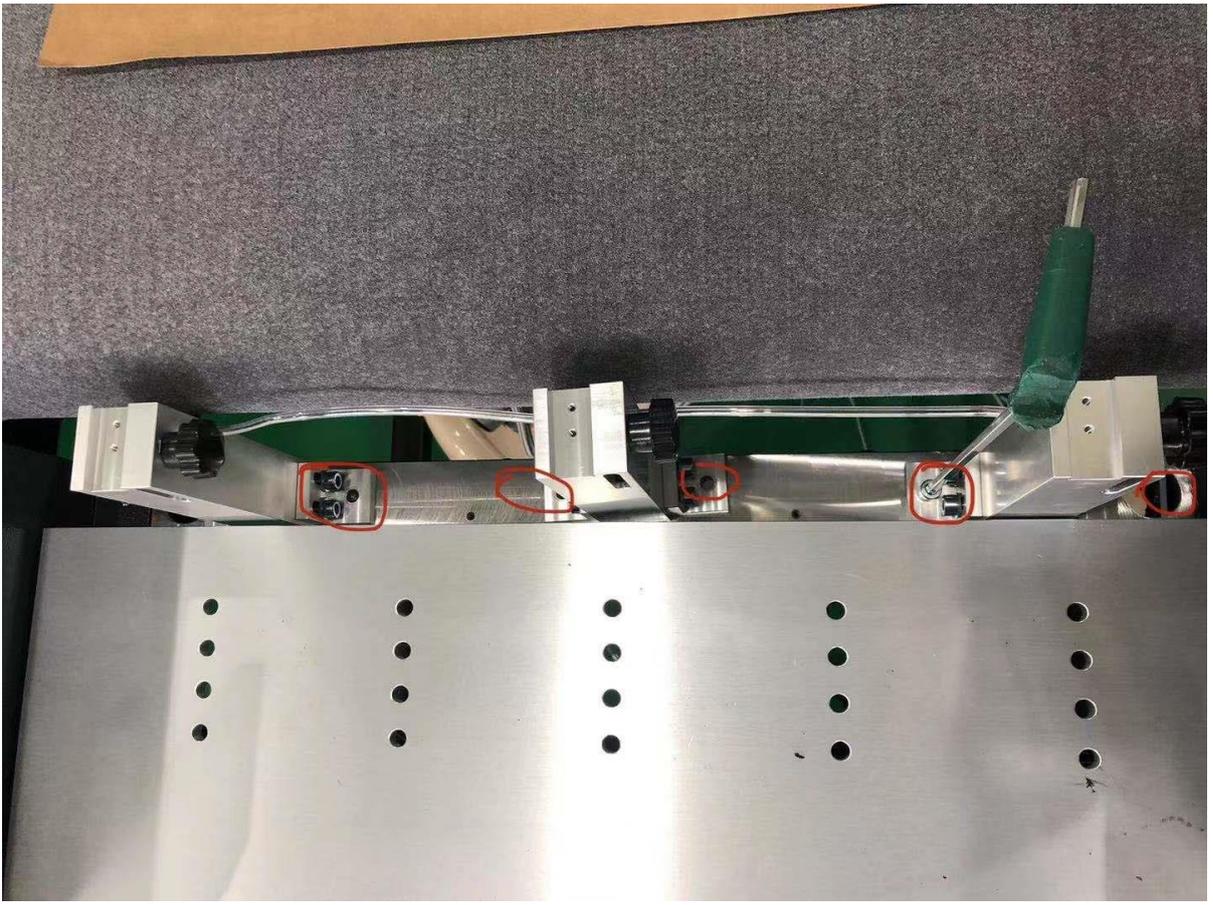



2. Reconnect the new trachea to ensure it can blow, but you need an 8 to 4 tracheal adapter, ensure that three 4-size tracheals can be connected to blow air. the tracheal connection method still follows the original path. pls refer to the photos below for details.

